




West Visayas State University
 (Formerly Iloilo Normal School)
OFFICE OF THE MANAGEMENT INFORMATION SYSTEM
 Luna St., La Paz, Iloilo City 5000
 Iloilo, Philippines

* Trunkline: (063) (033) 320-0870 loc 1163 * Telefax No.: (033) 320-0879
 * Website: www.wvsu.edu.ph * Email Address: mis@wvsu.edu.ph





PHI-18939-2-QM

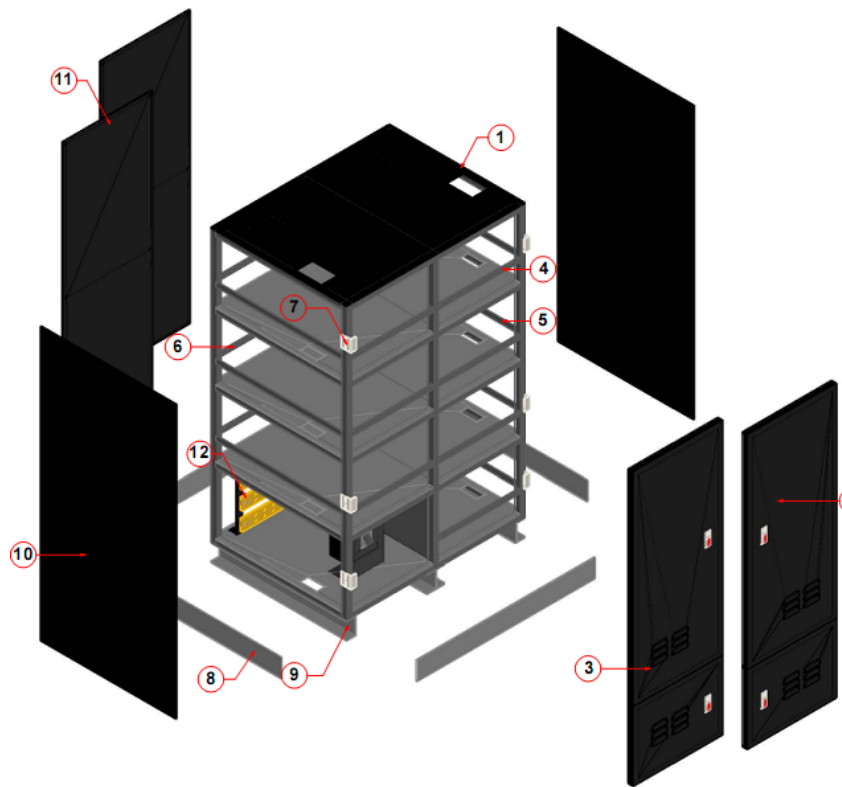

Item number	Quantity	Title
1	1	FRAME
2	2	RIGHTHANDDOORASSY
3	2	LEFTHANDDOORASSY
4	7	FRONTSUPPORT
5	7	SIDESUPPORT
6	7	REARSUPPORT
7	6	DOORHINGE
8	4	BOTTOMCOVERPANEL
9	1	PLINTASSEMBLY
10	2	SIDEPANEL
11	2	REARPANEL
12	1	BUSBARASSEMBLY

- NOTES:**
- CABINETMATERIALANDSHELFMATERIALSHOULD BE2mmZINCSEAL.
 - FINISHSHOULD BEPOWDERCOATED.
 - DOORSHOULD BE REMOVABLE VIA CHROME PLATED LIFT OFF HINGES.
 - PUSH PIN LOCK TO BE USED FOR THE DOORS.
 - VENTS SHOULD BE PROVIDED AT THE DOOR OF THE CABINET AND AT THE DOORS.
 - ALL SHARP CORNERS SHOULD BE CHAMFERED.
 - PROVIDE EAR RUBBER AT THE HELVES CUT OUT TO AVOID WIRE CUTS.
 - ALL SHELVES SHOULD BE WELDED ON THE CABINET FRAME.
 - DOOR REAR, LEFT AND RIGHT PANELS SHOULD BE REMOVABLE.
 - ESTIMATED TOTAL WEIGHT OF EMPTY CABINET **KGS.
 - PROVIDE TOP OR BOTTOM CABLE ENTRY.
 - SIDE AND REAR PANELS WERE REMOVED TO SHOW THE REAR SUPPORT.
 - BUSBAR FRAME IS TO BE BOLTED TO THE FRAME.

BATTERY	MAX.BLOCKS SHELF	WEIGHT BLOCK(kg)	MAX.WEIGHT (kg)
12V-42Ah	16	13.50	216

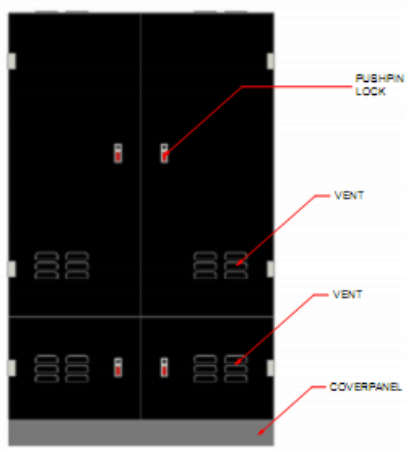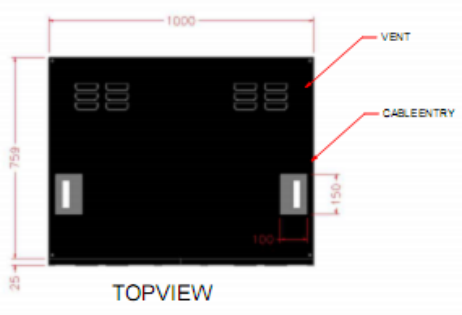

ISOMETRICVIEW


FRONTVIEW

SIDEVIEW




West Visayas State University
(Formerly Iloilo Normal School)
OFFICE OF THE MANAGEMENT INFORMATION SYSTEM
Luna St., La Paz, Iloilo City 5000
Iloilo, Philippines


* Trunkline: (063) (033) 320-0870 loc 1163 * Telefax No.: (033) 320-0879
* Website: www.wvsu.edu.ph * Email Address: mis@wvsu.edu.ph

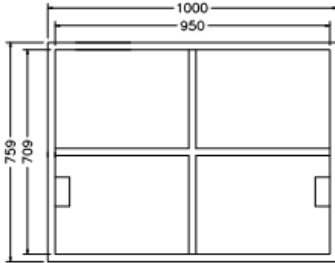

TOPVIEW

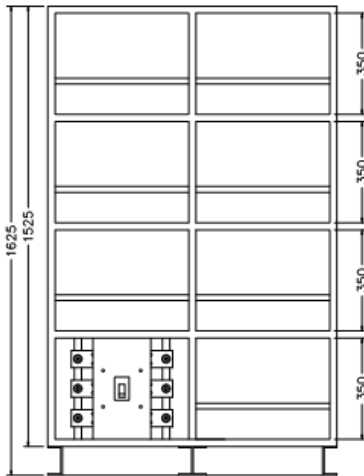

FRONTVIEW

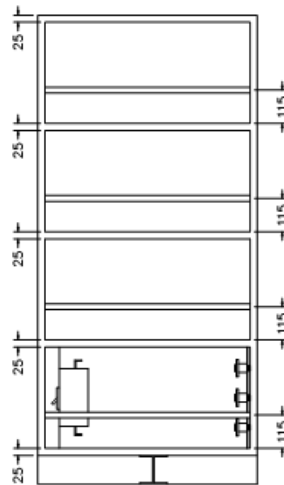

SIDEVIEW



ISOMETRICVIEW